
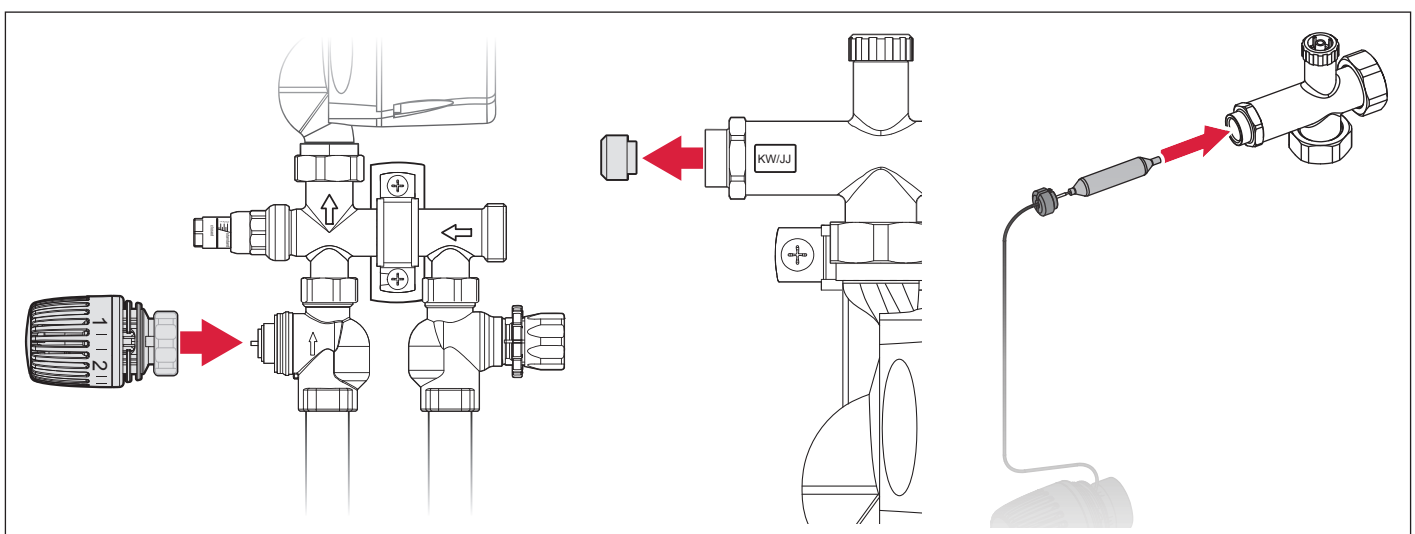



Temperatur	Temperature	
Primär	Primary	20-90° C
Sekundär	Secondary	20-55° C
p max.	p max.	6 bar

Pumpe	Pump	
U	U	230 V, 50 Hz
Q	Q	3,5 m³/h
H	H	6 mWs
P	P	3 ... 42 W
Glykol	Glycol	max. 30 vol%



Ventile	Valves	
Rücklaufventil	Return valve	kvs 2,7 m³/h
Thermostatventil	Thermostic valve	kvs 4,0 m³/h

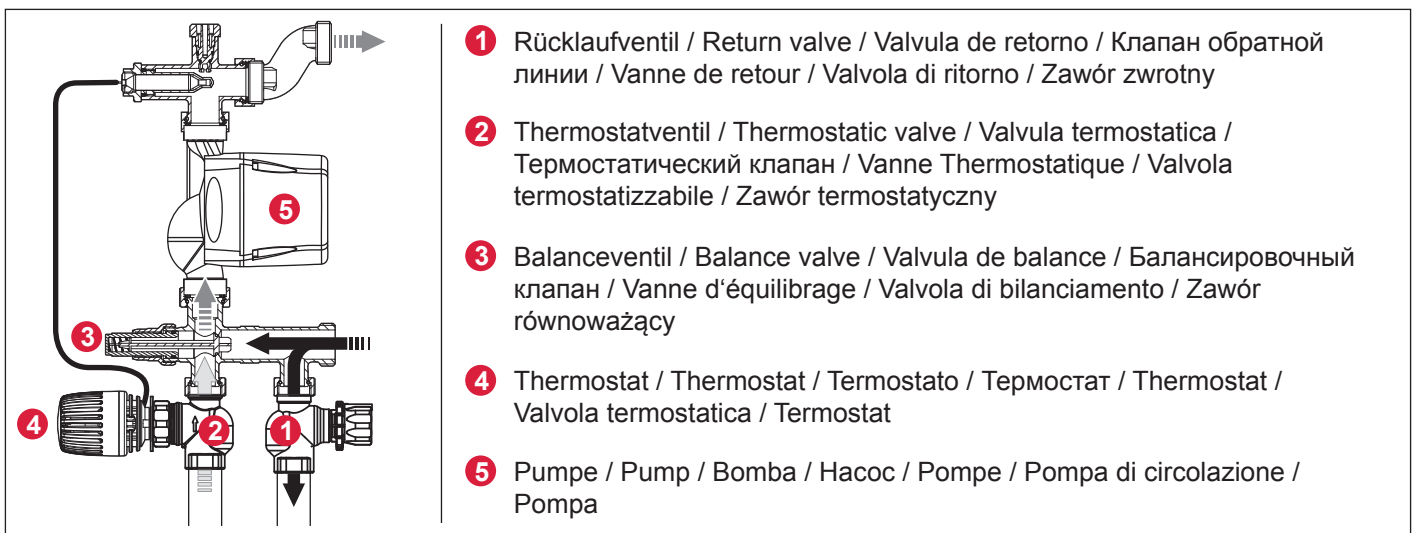

Thermostat	1	20° C
Thermostat	2	25° C
Termostato	3	30° C
Термостат	4	34° C
Thermostat	5	38° C
Valvola termostatica	6	42° C
Thermostat	7	46° C
Thermostat	8	50° C
Thermostat	9	55° C

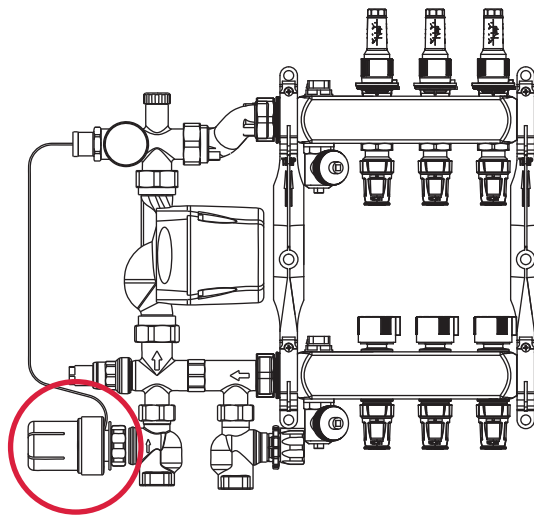


Befüllen
Filling
Llenado
заполнение
Remplissage
Riempimento
Napełnianie

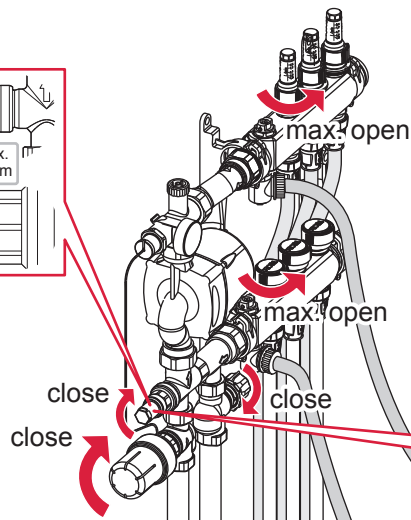



Nach dem Spülen
Ventil öffnen
 Open valve after
rinsing
 Después de la
descarga abrir la
válvula
 Открыть клапан
после промывки
 Ouvrir la vanne après
rinçage
 Aprire la valvola dopo
il rilavaggio
 Otwórz zawór po
przeptukaniu



Entlüften
Venting
Ventilar
Деаэрация
Purger
Sfiatare
Odpowietrzenie

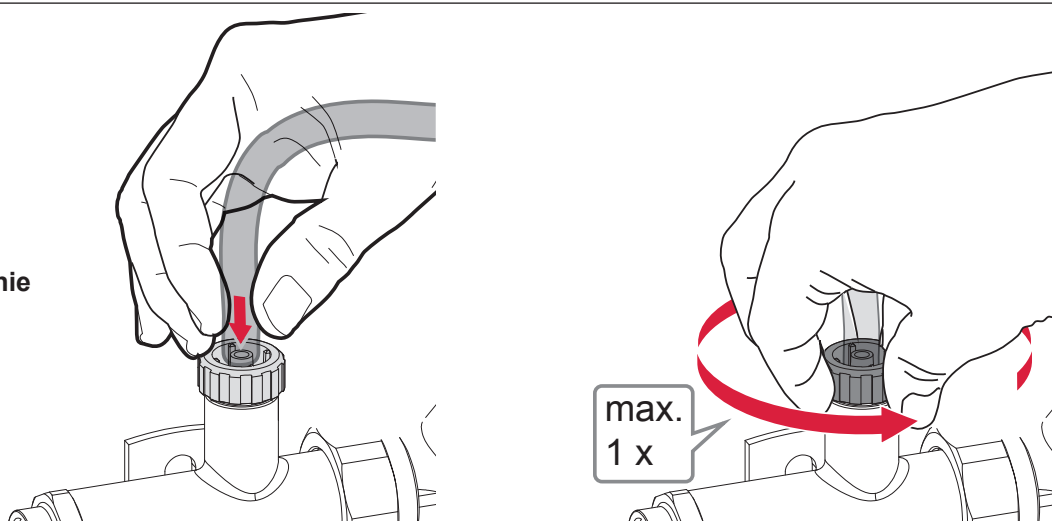



Pumpe / Pump / Bomba / Hacoc / Pompe / Pompa di circolazione / Pompa

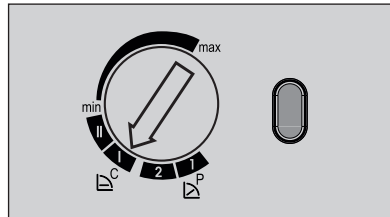

Programm	LED Light
P1/P2 = Δp variabel	green
C1/C2 = Δp constant	orange
Min-Max	blue
Error	red
Air control	white (flashing)

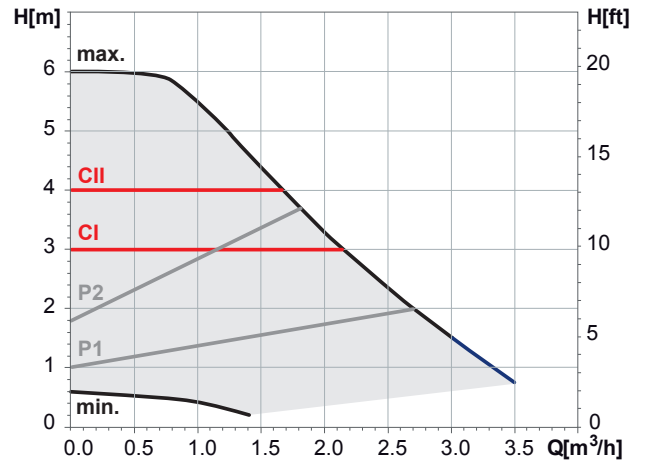

Rücklaufventil
Return valve
Valvula de retorno
Клапан обратной линии
Vanne de retour
Valvola di ritorno
Zawór zwrotny

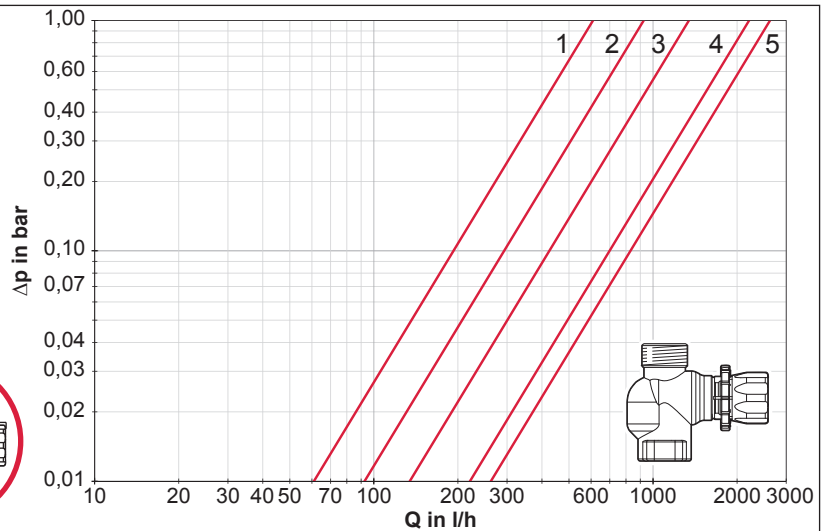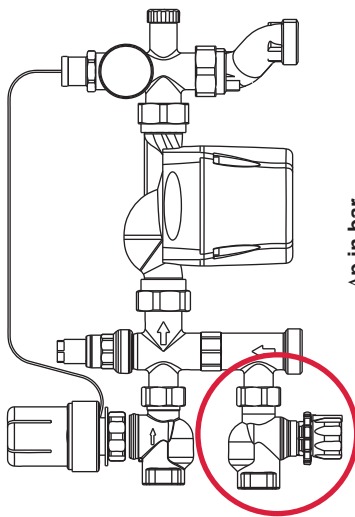

Balanceventil
Balance valve
Valvula de balance
Балансировочный клапан
Vanne d'équilibrage
Valvola di bilanciamento
Zawór równoważący

